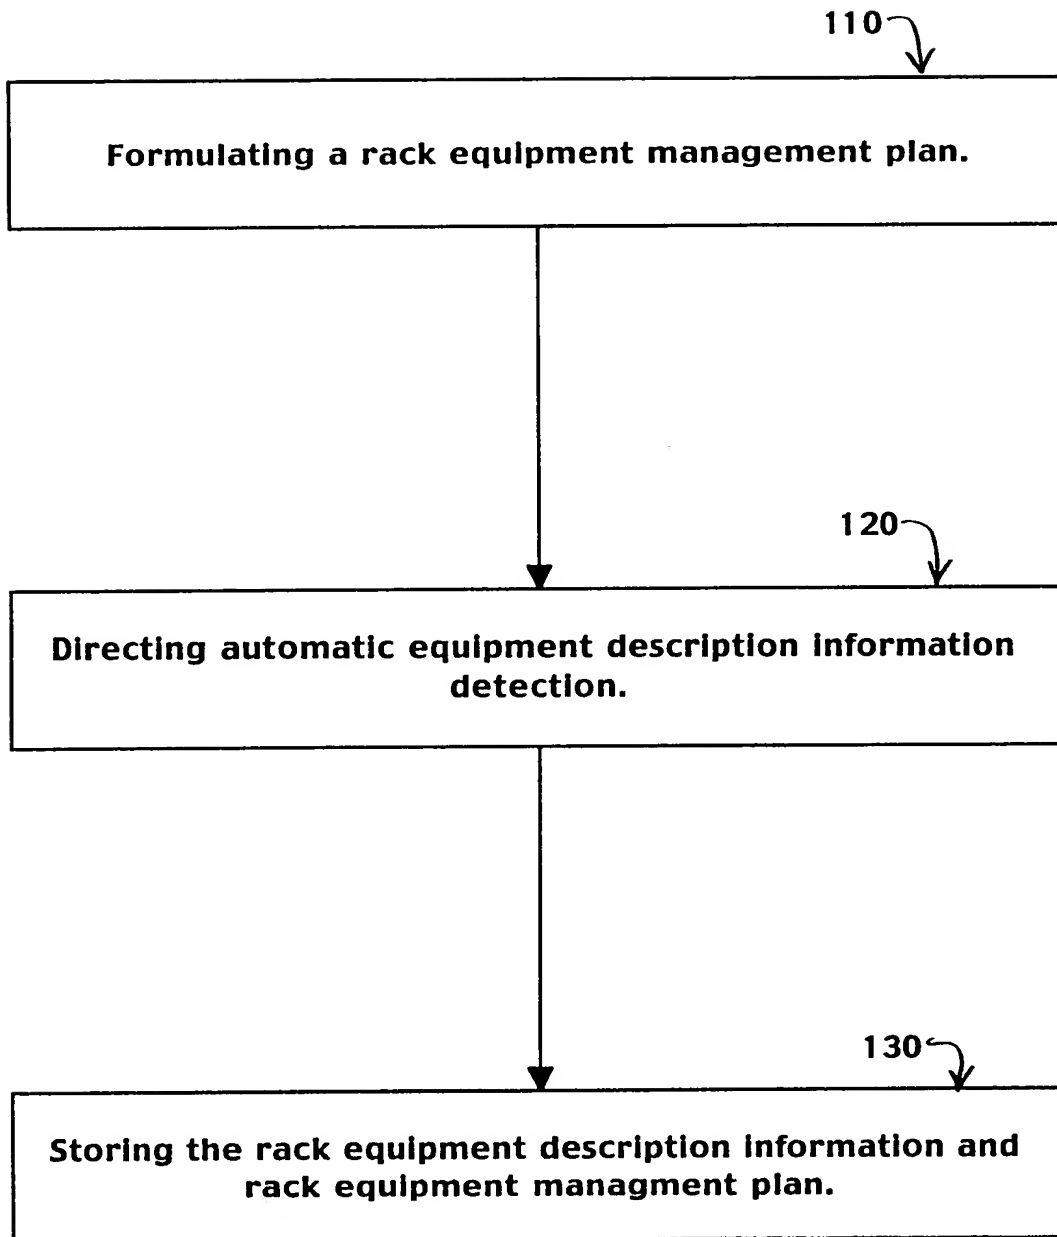


100



**FIG 1**

210

211 ↘ Location	212 ↘ Identification	213 ↘ Characteristic	214 ↘ Performance Level
Rack Number 1	Server Number 1	500 Mhz 400MHz	200W, 100W
Rack Number 1	Disk Array Number 1	10 Giga Bytes	300W
Rack Number 1	Server Number 2	1GHz	100W
Rack Number 2	Server Number 3	3GHz 2GHz 1GHz	200W, 100W, 50W
Rack Number 2	Server Number 4	1GHz	100W
Support Equipment	HVAC	1,000 BTU	Cool, Warm

FIG 2A

220

221 ↘ PLAN	222 ↘ Performance Level	223 ↘ Trigger Event Type 1	224 ↘ Trigger Event Type 2
PLAN 1	Top	None	High Priority Application
PLAN 2	Medium	Power Price Increase	Medium Priority Application
PLAN 3	Low	Power Supply Interruption	Low Priority Application

FIG 2B

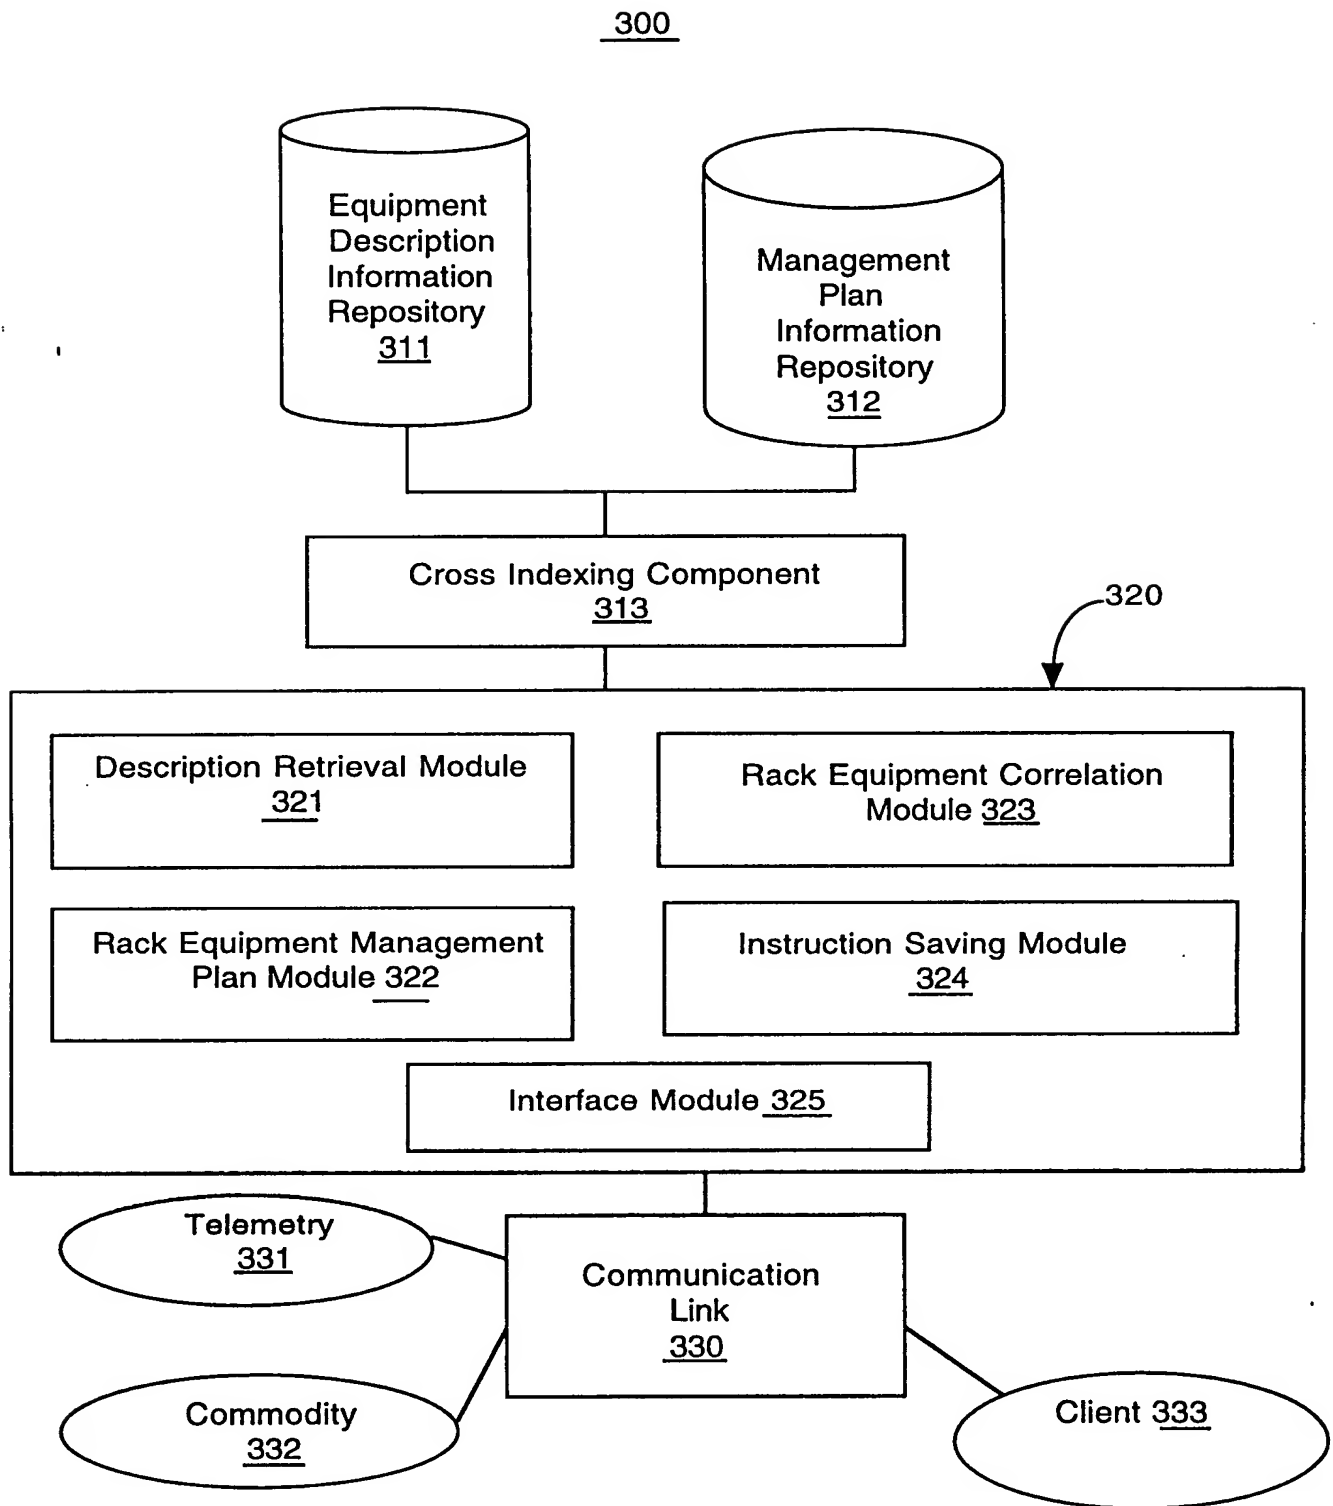


FIG 3

400

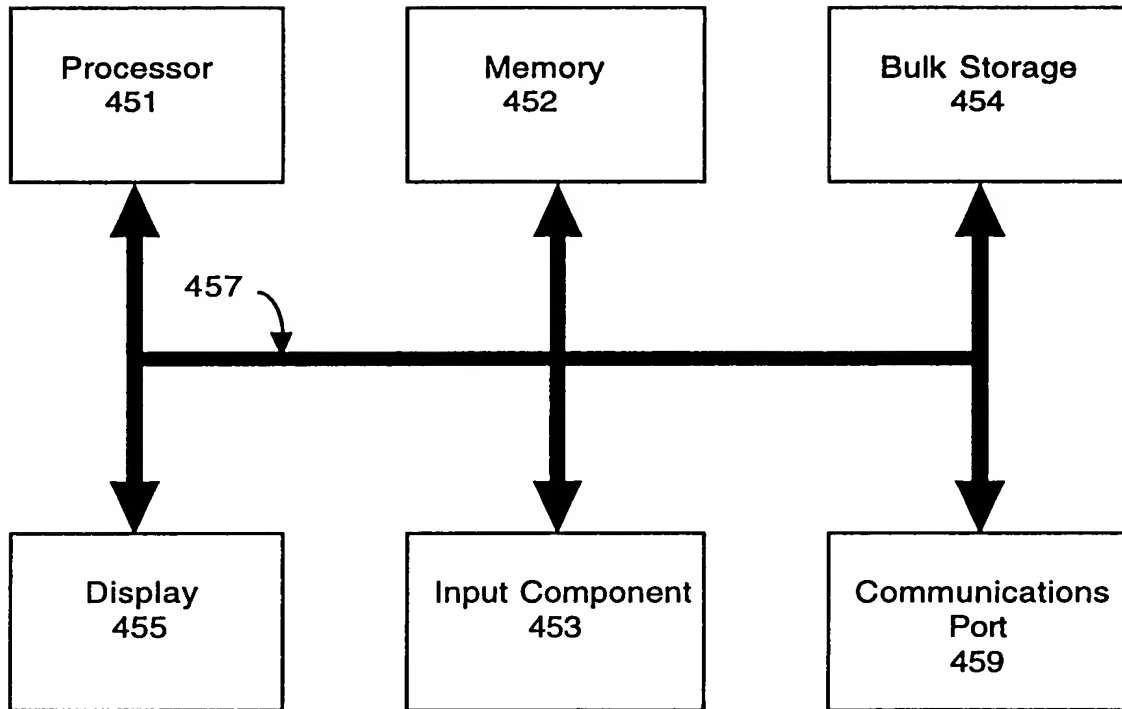


FIG 4